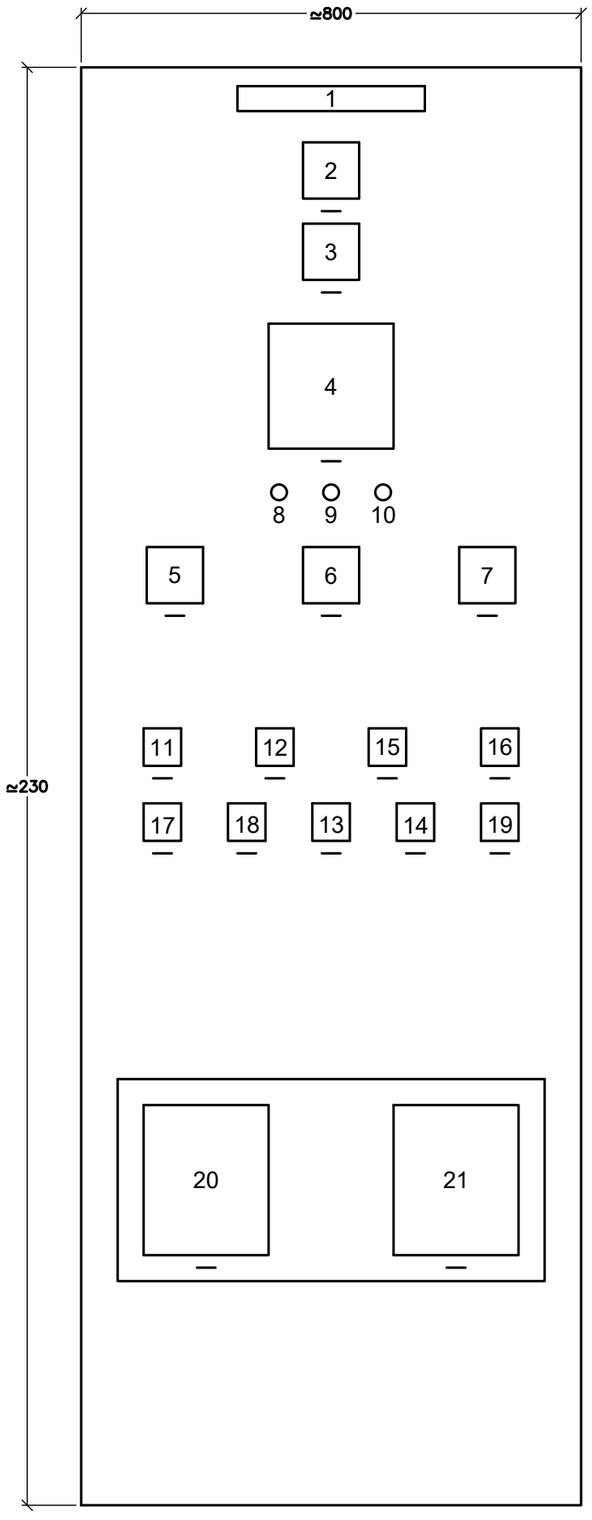


KEY:-

1-NAME PLATE

2-VOLTMETER

3-TAP POSITION INDICATOR

4-ANNUNCIATOR

5-132 KV WINDING TEMPERATURE

6-33 KV WINDING TEMPERATURE

7-OIL TEMPERATURE

8-LAMP TEST

9-LAMP ACKNOWLEDGE

10-RESET

11-VOLTMETER SELECTOR SWITCH

12-MANUAL - AUTO CONTROL SWITCH

13-RAISE PUSHBUTTON

14-LOWER PUSHBUTTON

15-REMOTE - SUPERVISORY SELECTOR SWITCH

16-MAST. - FOLL. - IND. - OFF SELECTOR SWITCH

17-OLTC IN OPERATION

18-OLTC OUT OF STEP

19-COOLERS RUNNING

20-REMOTELY CONTROLLABLE VOLTAGE LEVEL SETTING DEVICE

21-AVR RELAY

NOTE:- UNIT 20+21 MAY INCORPORATED IN ONE SET

FOR TENDER PURPOSE ONLY

REV.	DATE	DESCRIPTION	DRN.	DES.	CHK.	APP.

NATIONAL ELECTRIC POWER CO.

NATIONAL CONVEYANCE
400/132/33kV AAWDCP S/S
TYPICAL ARRANGMENT DRAWING FOR AVR PANEL

DRN : T.HEKMAT	DATE : 16.09.2026	DRG. No.	REV.
DES : A.HIJAZI	SCALE : N.T.S	7-18-E3-0015	0
CHK : R.HELO	DIM.IN :		
APP : A.SHDAIFAT			

TENDER No. 75/2026