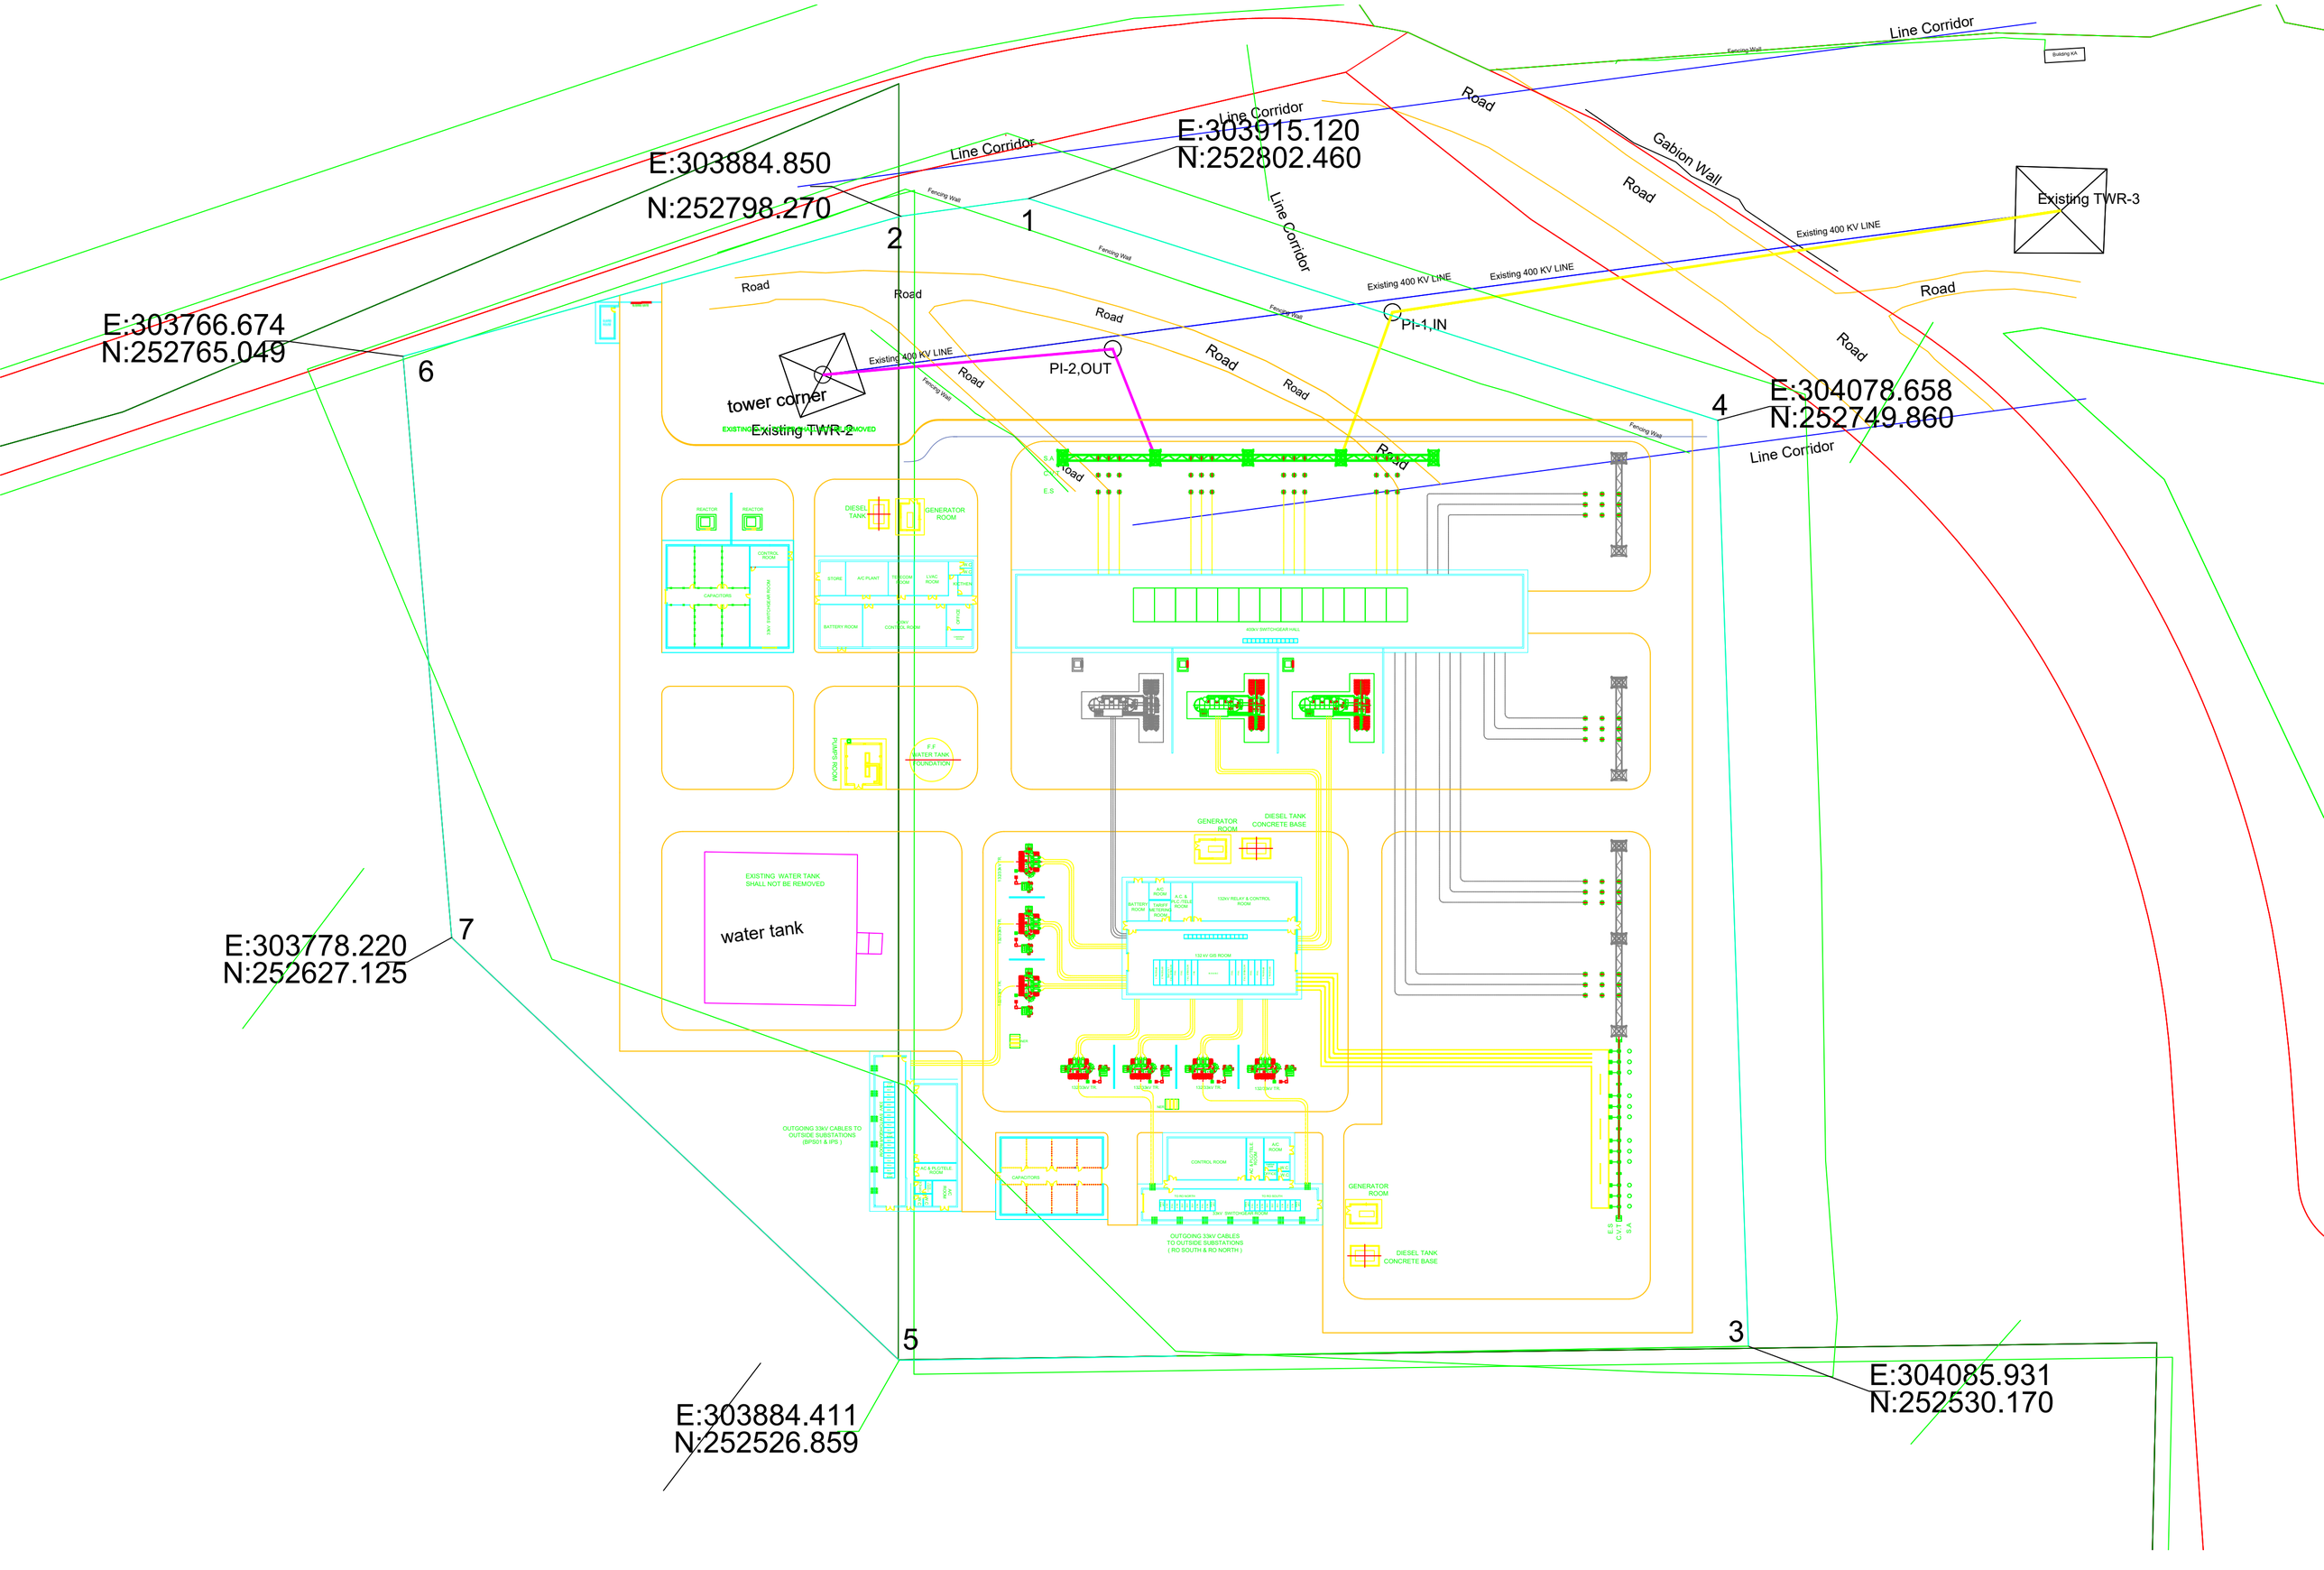

E:303766.674
N:252765.049
6
E:303884.850
N:252798.270
2
1
E:303915.120
N:252802.460
Line Corridor
Fencing Wall
Road
Gabion Wall
Existing TWR-3
Existing 400 KV LINE
PI-1,IN
PI-2,OUT
tower corner
Existing TWR-2
EXISTING TOWER TO BE REMOVED
4
E:304078.658
N:252749.860
Building KA
REACTOR
CONTROL ROOM
CAPACITORS
MODULAR SWITCHGEAR + AVC
DIESEL TANK
GENERATOR ROOM
STORE
A/C PLANT
TELECOM ROOM
LV/AC ROOM
KITCHEN
BATTERY ROOM
400kV CONTROL ROOM
LIFT
PUMPS ROOM
F.F WATER TANK FOUNDATION
S.A
CVT
E.S
400kV SWITCHGEAR HALL
EXISTING WATER TANK SHALL NOT BE REMOVED
water tank
7
E:303778.220
N:252627.125
OUTGOING 33kV CABLES TO OUTSIDE SUBSTATIONS (BPS01 & IPS)
A/C
A/C & ELCTRLE. ROOM
132kV RELAY & CONTROL ROOM
132 kV GIS ROOM
OUTGOING 33kV CABLES TO OUTSIDE SUBSTATIONS (RG SOUTH & RG NORTH)
5
3
E:303884.411
N:252526.859
E:304085.931
N:252530.170